

No.	REVISION	BY	DATE	AUTH
0	ISSUED	CL	01/2016	

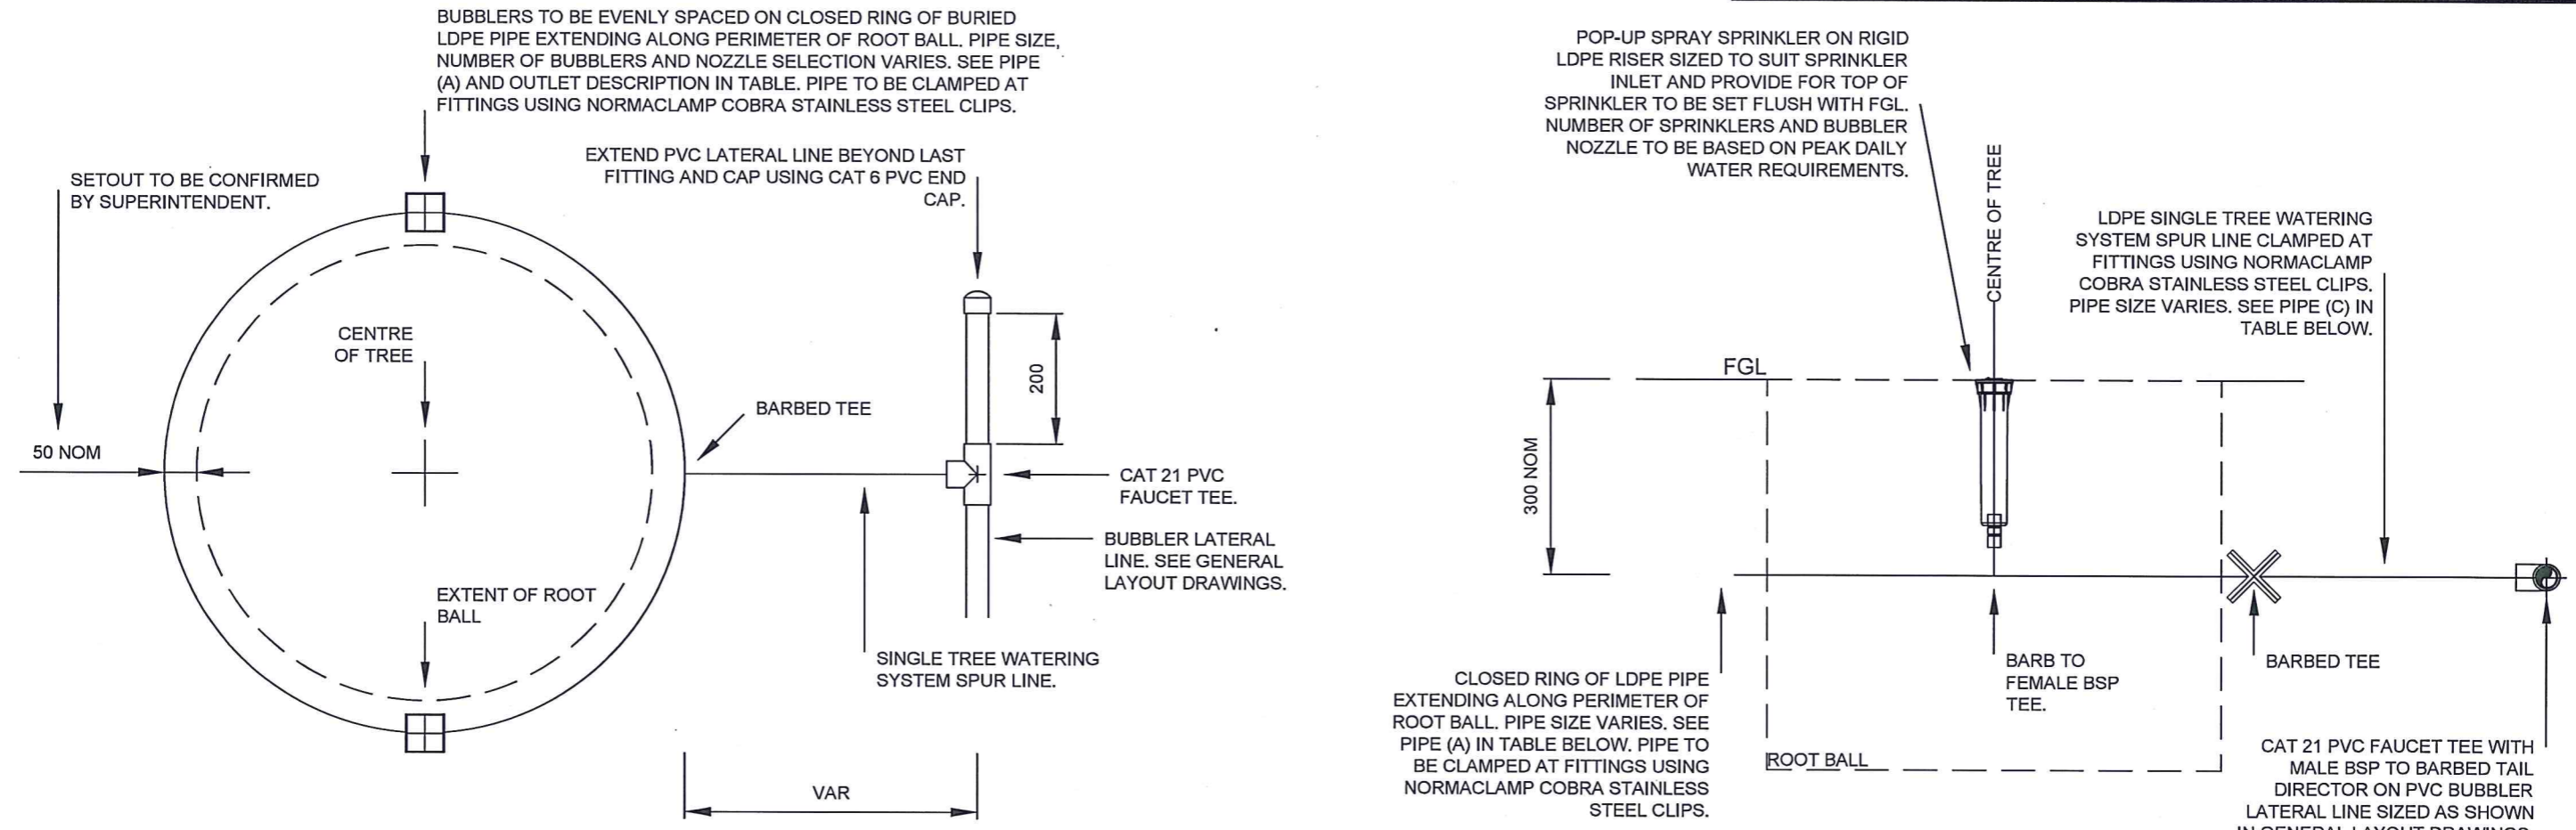


TABLE OF TREE WATERING SYSTEMS†						
SYSTEM	PLANT STOCK‡	SYSTEM FLOW (L/MIN)	20MIN VOL (L)‡	PIPE (A)	PIPE (B)	PIPE (C)
-	-	0-6	-	DN19	-	DN19
-	-	6-15	-	DN19	-	DN25
-	-	15-30	-	DN25	-	DN25

† SYSTEM DESIGN BASED ON THE PEAK DAILY WATER REQUIREMENTS SUPPLIED BY NURSERY INDUSTRY SOURCES AND OTHERS
‡ BAG STOCK SIZE (L) AND/OR NOMINAL DIAMETER OF TRANSPLANT ROOT BALL (M).
‡ VOLUME PROVIDED BY A 20MIN RUN TIME. RUN TIME TO BE ADJUSTED IN ACCORDANCE WITH PLANT WATER REQUIREMENTS AND CLIMATIC CONDITIONS.

TREE WATERING SYSTEMS

SCALE: NOT TO SCALE SCALE IN MILLIMETRES	DATUM: N/A	GRID: N/A
SURVEYED: N/A SURVEYOR: / /2016	CHECKED: [Signature] TECHNICAL OFFICER - IRRIGATION 08/02/2016	
DESIGNED: X.XXXX CIVIL PROJECTS DESIGNER / /2016	AUTHORISED: [Signature] MANAGER PARKS AND RESERVES MAINTENANCE 08/02/2016	
DRAWN: X.XXXX CIVIL PROJECTS DESIGNER / /2016	APPROVED: [Signature] DIRECTOR ASSET MANAGEMENT 9/2 /2016	

IRRIGATION
TREE WATERING SYSTEMS

STANDARD SHEET 1 OF 1

CITY OF WANNEROO			
INFRASTRUCTURE			
FILE No. N/A	DRAWING No. TS 40-17-0	SHEET REVISION	ORIGINAL DRG. SIZE A3
PROJECT No. N/A			