


| No | REVISION                     | BY     | DATE   | AUTH |
|----|------------------------------|--------|--------|------|
| 0. | ISSUED                       | J.W.T. | 8/2001 |      |
| 1. | RE-DRAWN TO REFLECT NEW TYPE | D.N.   | 3/2018 | Z.K. |
|    |                              |        |        |      |
|    |                              |        |        |      |

## NOTES:

- 1. ALL COMPONENTS TO BE DESIGNED TO ACCEPT A14 LOADING AUSTROADS STANDARDS
- 2. MOTAR TO BE 3:1 SAND/CEMENT MIXTURE
- BASE TO BE BEDDED ON COMPACTED SAND
- 4. INSITU CONCRETE TO HAVE MIN. STRENGTH OF 32 MPa AT 28 DAYS.



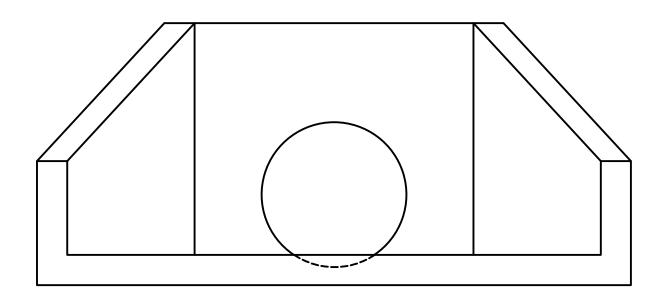

SIDE ELEVATION

DESIGNED:

DESIGN CHECKED:

STANDARDS/DOCUMENT CONTROL: <sup>t</sup> J. TRIMMER

8/8/2001

DESIGNER

SURVEYOR:

0 100 200 300

SCALE IN MILLIMETRES

N/A

N/A

DATUM:

N/A

1:10

DESIGN ARCHIVE:

DRAWING ARCHIVE:

\*\FINAL STANDARD DRAWINGS

**END ELEVATION** 

ORIGINAL ISSUE OF DRAWING. APPROVED: C.O.W. + T. QUINN 8/8/2001 C.O.W.

\* INDICATES SIGNATURES ON

\* R. KORENHOF 8/8/2001 Manager infrastructure APPROVED:

\* D. BLAIR INFRASTRUCTURE TECHNICAL OFFICER DIRECTOR TECHNICAL SERVICES

LOCALITY

DRAINAGE

HEADWALL DETAILS

**CITY OF WANNEROO TECHNICAL SERVICES** 



**INFRASTRUCTURE SERVICES** 

FILE No.

STANDARD