

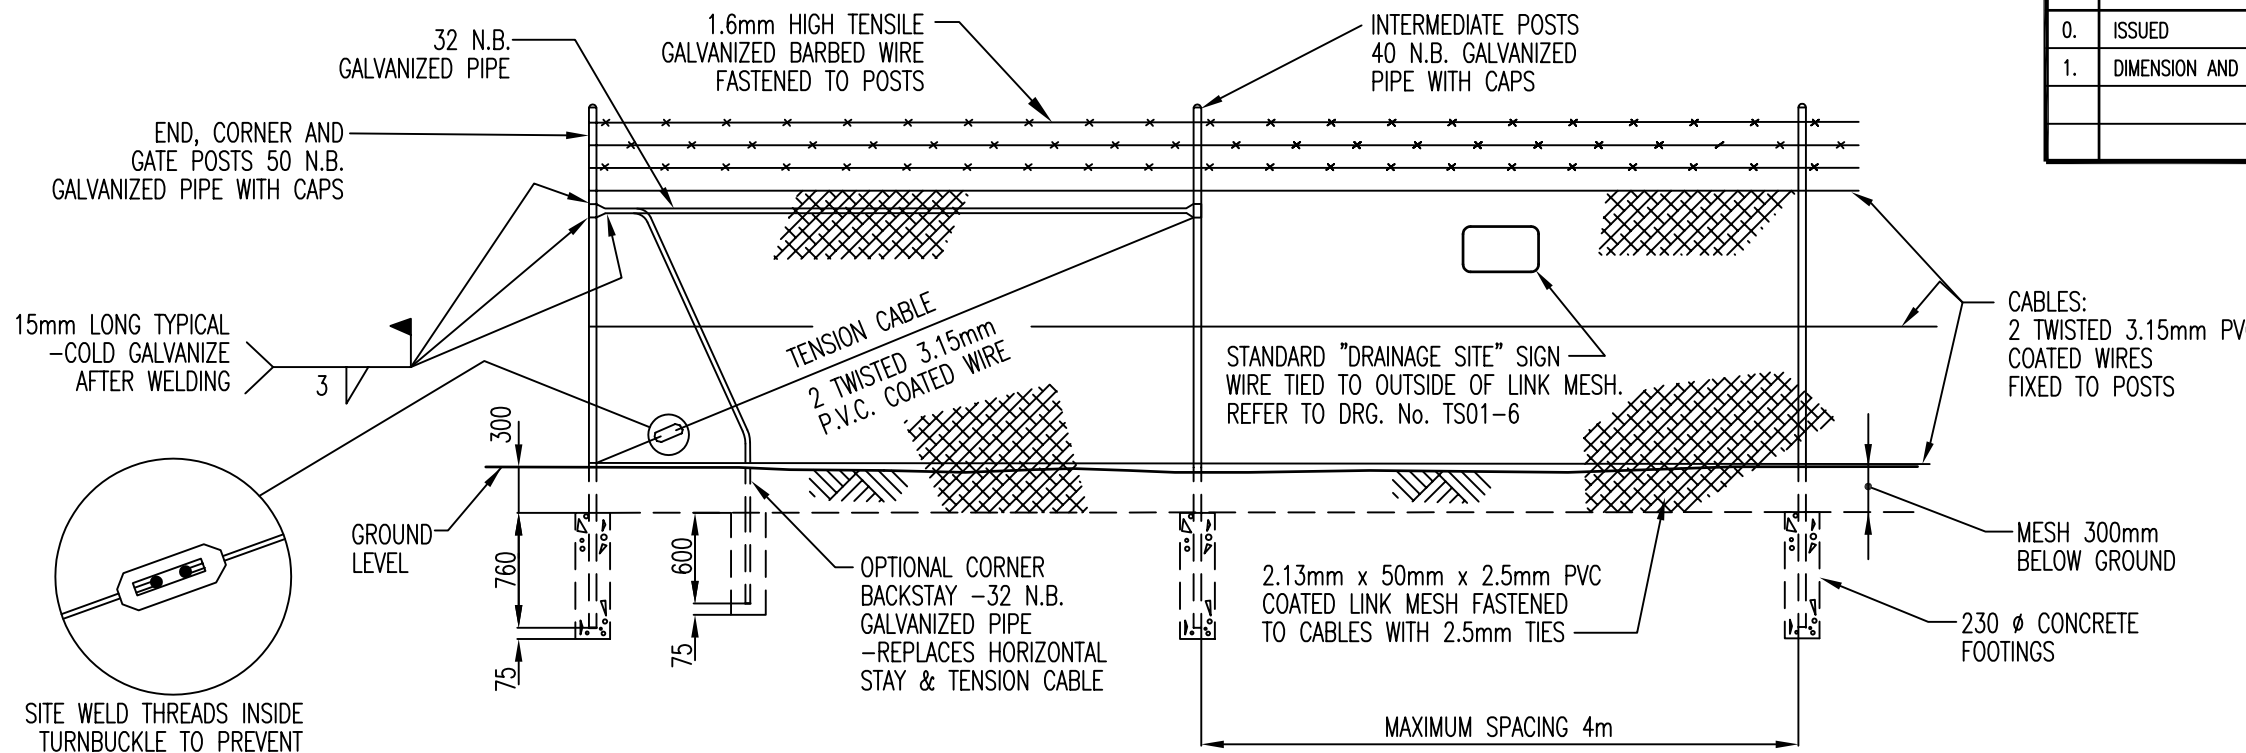


No	REVISION	BY	DATE	AUTH
0.	ISSUED	J.W.T.	8/2001	
1.	DIMENSION AND NOTES AMENDED	T.T.	3/2006	B.C.

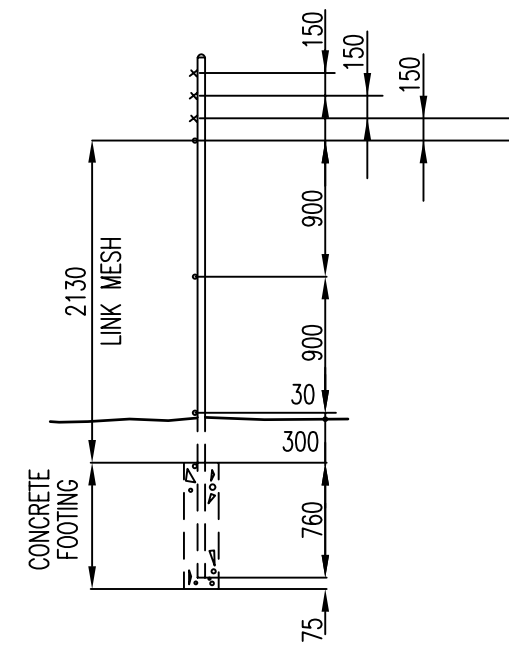

- NOTES:**
- FENCE TO BE SET 1000mm INSIDE RESERVE BOUNDARY ADJACENT TO PRIVATE PROPERTY AND ON RESERVE BOUNDARY ADJACENT TO RECREATION & ROAD RESERVES.
 - DROP BOLT TO LOCATE IN SLEEVE SET IN CONCRETE CROSSOVER, TO SUPPORT THE MIDDLE OF THE GATE.
 - FORM CONCRETE CROSSOVER AS PER DRG TS07-2 FROM BACK OF KERB TO 300mm (MIN) INSIDE GATE.
 - ALL UPRIGHT MEMBERS SHALL BE VERTICAL WITHIN A TOLERANCE OF 1:100.
 - THE BASE OF FOOTING HOLES SHALL BE ADEQUATELY COMPACTED BY RAMMING.
 - CONCRETE FOOTING SHALL BE MIXED IN THE PROPORTIONS OF (4) PARTS BY WEIGHT OF CLEAN DUST FREE AGGREGATE (NOT EXCEEDING 20mm SIZE) PLUS TWO (2) PARTS BY WEIGHT OF CLEAN DUST FREE SAND PLUS ONE (1) PART BY WEIGHT OF MASONRY CEMENT, WITH WATER CONTENT SUFFICIENT TO ENSURE A SLUMP OF NOT MORE THAN 100mm USING THE AUSTRALIAN STANDARD SLUMP TEST CONE.
 - CONCRETE SHALL ACHIEVE A MINIMUM COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS.
 - CONCRETE FOOTINGS SHALL BE CURED FOR TWENTY FOUR (24) HOURS BEFORE ERECTION OF WIRES OR MESH TO POSTS.
 - THE MESH AND WIRE SHALL BE PLACED ON THE OUTSIDE FACE OF POSTS AND UPRIGHTS, AND TENSIONING CABLES AND TURNBUCKLES SHALL BE PLACED ON THE INTERNAL SIDE OF THE COMPOUND/SUMP BEING FENCED.
 - GALVANISED COATINGS FOR ALL FERROUS MATERIALS SHALL HAVE COATINGS OF ZINC IN COMPLIANCE WITH AS1650 (GALVANISED COATINGS ON FERROUS ARTICLES). THE COATING FOR WIRE SHALL BE TYPE A (HEAVILY GALVANISED). THE PVC COATING OR COLOURBOND COATING TO WIRE SHALL BE BLACK, UNLESS OTHERWISE DIRECTED BY THE CITY.

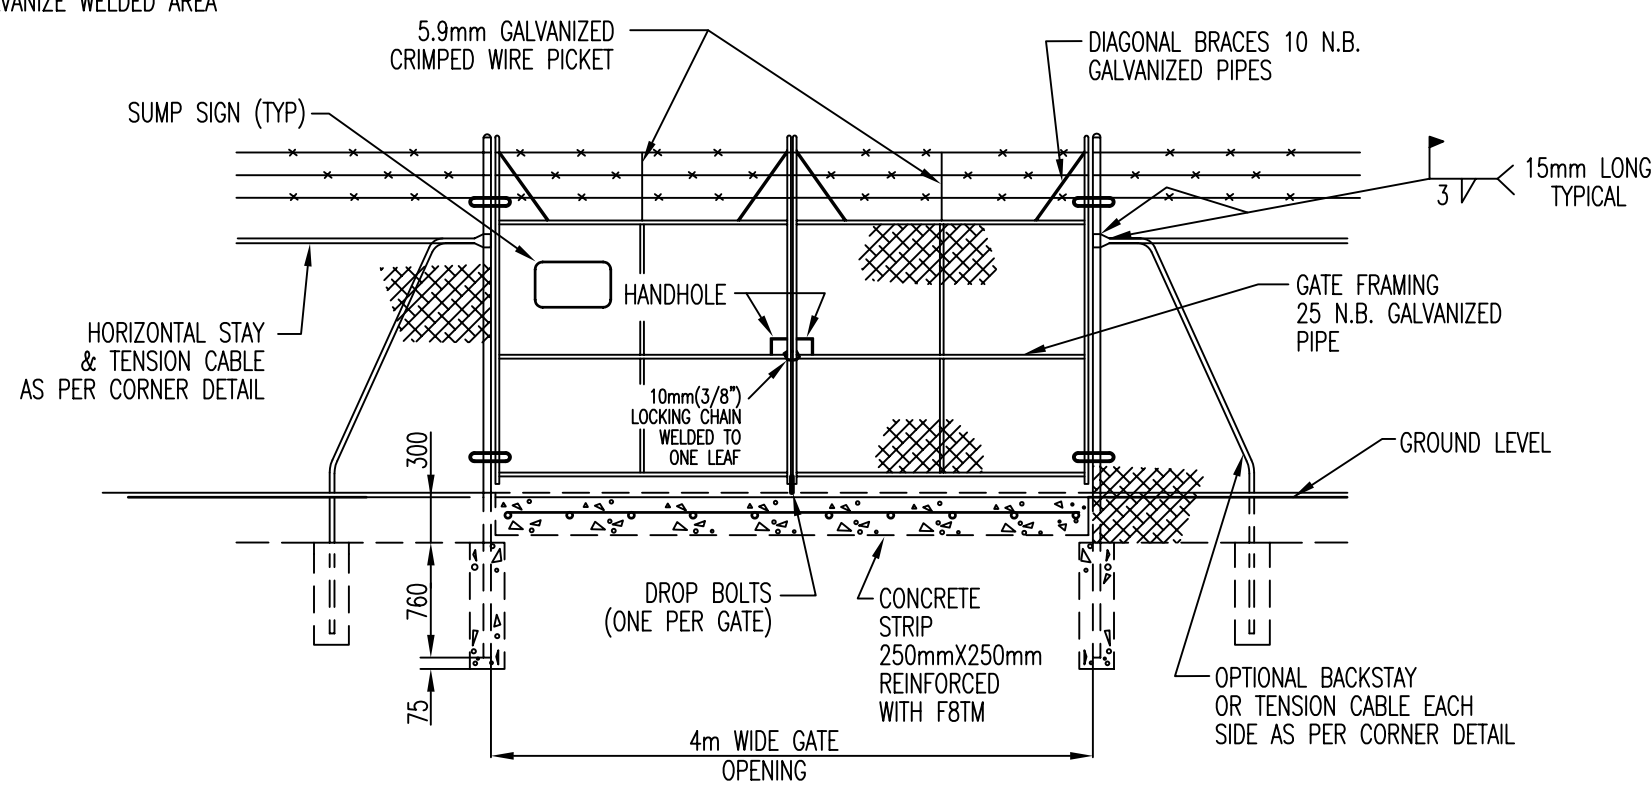

GATE DETAIL * INDICATES SIGNATURES ON ORIGINAL ISSUE OF DRAWING.

SECTION

DATUM: N/A	GRID: N/A	SURVEYOR: N/A	DESIGNED: C.O.W.	APPROVED: * T. QUINN 8/8/2001
SCALE: 1:50 SCALE IN MILLIMETRES	DRAWN: C.O.W.		DESIGN CHECKED: DESIGNER	COORDINATOR: APPROVED: * R. KORENHOF 23/8/2001 MANAGER INFRASTRUCTURE
DESIGN ARCHIVE:	STANDARDS/DOCUMENT CONTROL: * J. TRIMMER 8/8/2001 INFRASTRUCTURE TECHNICAL OFFICER		APPROVED: * D. BLAIR 23/8/2001 DIRECTOR TECHNICAL SERVICES	
DRAWING ARCHIVE: *FINAL STANDARD DRAWINGS				

**FENCING
SUMP SECURITY**

LOCALITY STANDARD

**CITY OF WANNEROO
TECHNICAL SERVICES**

INFRASTRUCTURE SERVICES

FILE No.	DRAWING No	SHEET	REVISION	ORIGINAL DRG. SIZE
	TS 01 - 2 - 1			A3