

No.	REVISION	BY	DATE	AUTH
0	ISSUED	CL	01/2016	

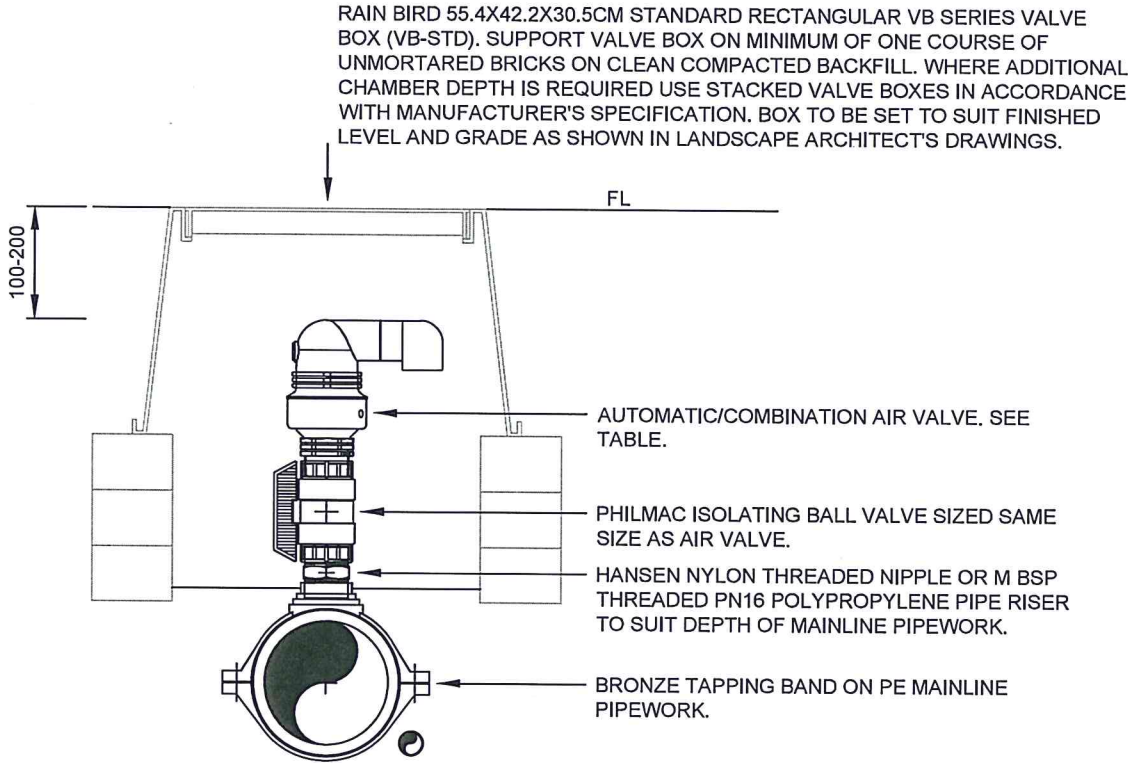


TABLE OF AIR VALVES	
MAINLINE SIZE (DN)†	AIR VALVE‡
≤63	PN16 DN20 COMBINATION AIR VALVE
75-140	PN16 DN25 COMBINATION AIR VALVE
150-200	PN16 DN50 COMBINATION AIR VALVE
† SEE GENERAL LAYOUT DRAWING(S).	
‡ SEE ALSO SPECIFICATION.	

TYPICAL AIR VALVE INSTALLATION ON MAINLINE PIPEWORK

SCALE: NOT TO SCALE SCALE IN MILLIMETRES		DATUM: N/A	GRID: N/A	IRRIGATION AIR VALVE INSTALLATION ON MAINLINE PIPEWORK	CITY OF WANNEROO INFRASTRUCTURE				
SURVEYED: N/A / / 2016 SURVEYOR:		CHECKED: [Signature] 08/02/2016 TECHNICAL OFFICER - IRRIGATION			FILE No. N/A	DRAWING No. TS 40-10-0		SHEET 1 OF 1 REVISION	ORIGINAL DRG. SIZE A3
DESIGNED: X.XXXX / / 2016 CIVIL PROJECTS DESIGNER		AUTHORISED: [Signature] 08/02/2016 MANAGER PARKS AND RESERVES MAINTENANCE			PROJECT No. N/A				
DRAWN: X.XXXX / / 2016 CIVIL PROJECTS DESIGNER		APPROVED: [Signature] 9/2 /2016 DIRECTOR ASSET MANAGEMENT		STANDARD SHEET 1 OF 1					