



No.	REVISION	BY	DATE	AUTH
0	ISSUED	CL	01/2016	


TABLE OF DRIPPERLINES	
AREA†	SPECIFICATION
 DRIP IRRIGATED GARDEN GENERAL.	NETAFIM UNIRAM CNL 16010 DRIPPERLINE WITH 1.6L/HR EMITTERS SPACED AT 0.30M CENTRES. DRIPPERLINES TO BE LAID WITH AN INTERVAL OF 0.40M BETWEEN DRIPPERLINES.
• X. † SEE GENERAL LAYOUT DRAWINGS.	

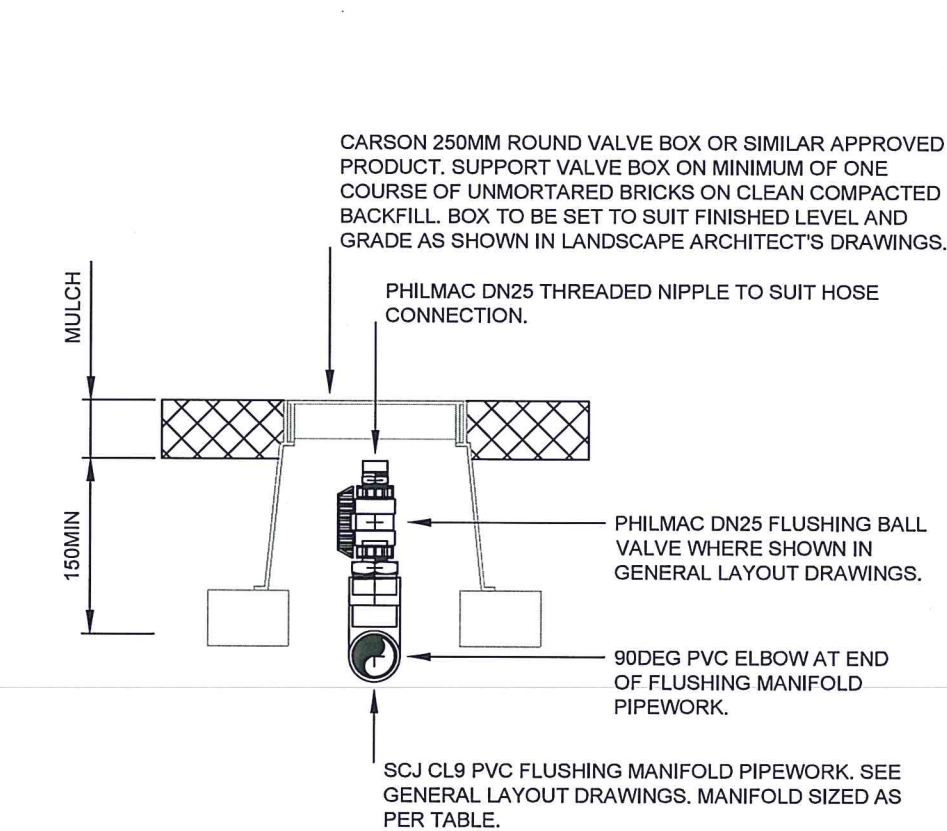

TYPICAL FLUSHING VALVE INSTALLATION ON DRIP MANIFOLD PIPEWORK

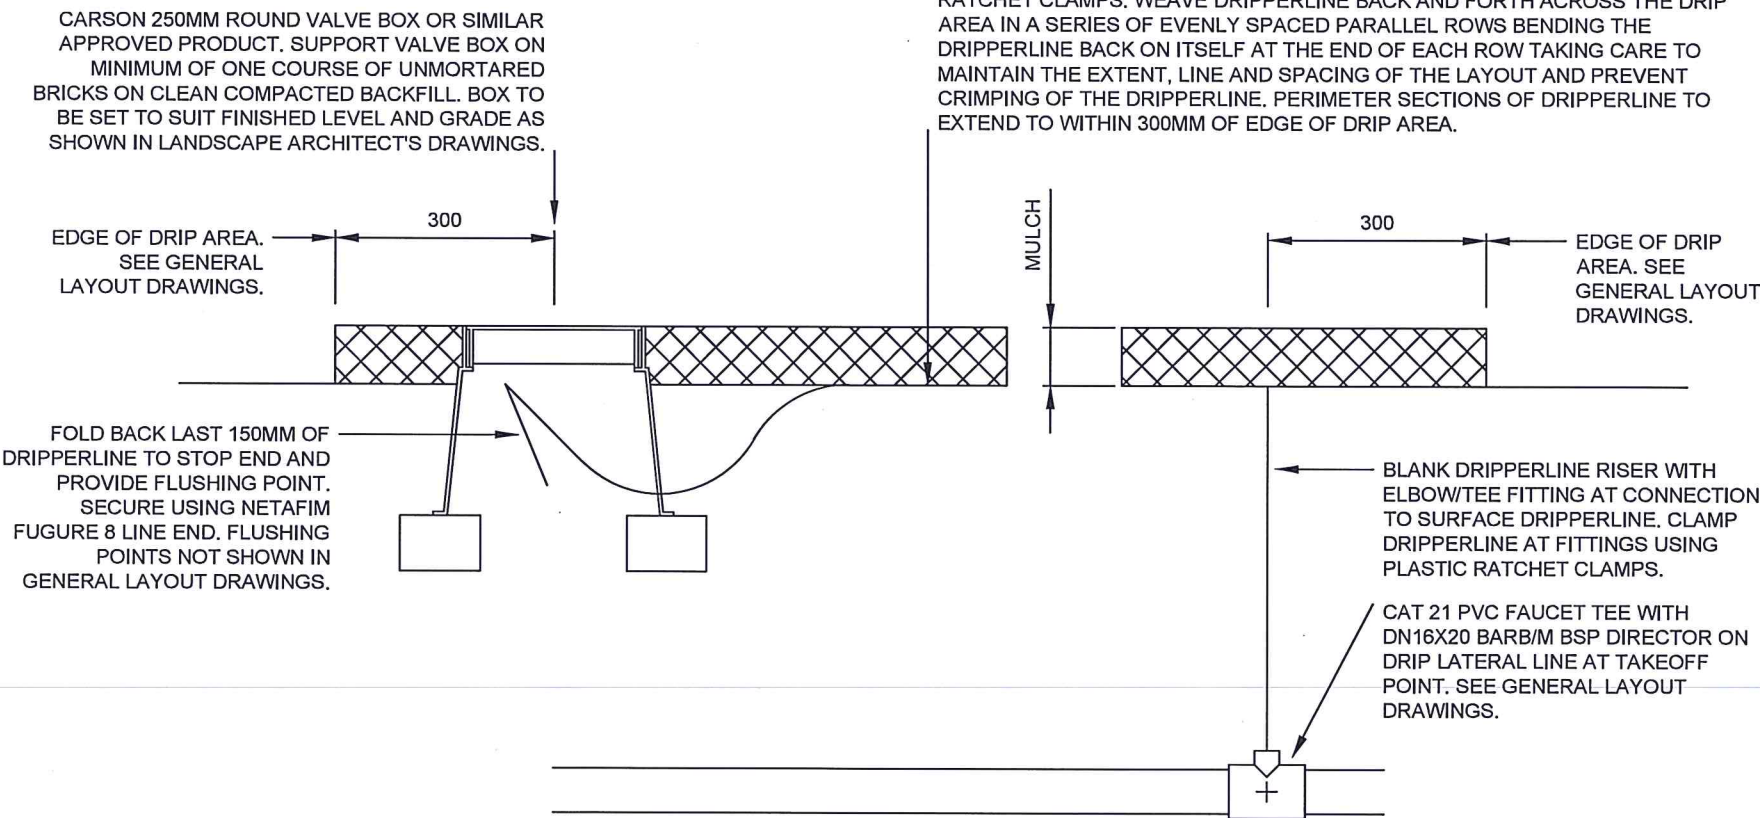

TYPICAL LITE LAYOUT INSTALLATION OF SURFACE LAID DRIPPERLINE FOR AREAS MEASURING LESS THAN 100M2

SCALE: NOT TO SCALE SCALE IN MILLIMETRES	DATUM: N/A	GRID: N/A
SURVEYED: N/A SURVEYOR: / /2016	CHECKED:  TECHNICAL OFFICER - IRRIGATION: 08/02/2016	
DESIGNED: X.XXXX CIVIL PROJECTS DESIGNER: / /2016	AUTHORISED:  MANAGER PARKS AND RESERVES MAINTENANCE: 08/02/2016	
DRAWN: X.XXXX CIVIL PROJECTS DESIGNER: / /2016	APPROVED:  DIRECTOR ASSET MANAGEMENT: 9/2/2016	

IRRIGATION DRIP DETAIL		CITY OF WANNEROO INFRASTRUCTURE		
STANDARD SHEET 3 OF 3		FILE No. N/A	DRAWING No. TS 40-13-0	
		PROJECT No. N/A	SHEET REVISION	ORIGINAL DRG. SIZE A3