

## LEGEND

-  DAP Boundary  
 Density Code  
 R25  
 R30  
 Lots subject to Quiet House Design Requirements

## PROVISIONS

The provisions addressed below relate to Detailed Area Plan No. 3 Atelier Village.

The City of Wanneroo District Planning Scheme No. 2 and Residential Design Codes apply unless otherwise provided for below.

The following standards are deemed to meet the relevant Design Principles of the R Codes and do not require consultation with the adjoining landowners.

Building Setbacks	Minimum
R30 Lots	3.0m minimum primary street setback (2.5m for lots 1399, 1400, 1403, 1404, 1413 & 1414)

### OPEN SPACE PROVISIONS

For all R30 lots only

- A minimum of 35% open space where the outdoor living area is located on the northernmost or easternmost boundary.

### BOUNDARY WALL PROVISIONS

For all R30 lots only

- Boundary walls are permitted to both side boundaries (excluding secondary street boundaries) providing the second boundary wall is a maximum length of 6m behind the front setback line to a maximum height of 3.5m.

### R25 LOTS

- Provision as per clause 9.2.4 of ASP 60.

### QUIET HOUSE DESIGN REQUIREMENTS

Facade Protection (Quiet house design measures) are not required for any dwellings at the ground floor level. 'Package A' is required at upper floors for dwellings on Lots 1408 & 1409, 1422 - 1428 inclusive and 'Package B' at upper floors for Lots 1396, 1407 & 1410 as defined in the Lloyd George Acoustic Report dated 5 August 2013.

Details of the Quiet House Design requirements are included in Attachment 1.

## ENDORSEMENT

This Local Development Plan has been endorsed by Council under Clause 52(1)(a) of the Deemed Provisions of District Planning Scheme No. 2



 23/1/17

Manager Approval Services - City of Wanneroo Date

POS  
1433 RESERVE



## LOCATION PLAN

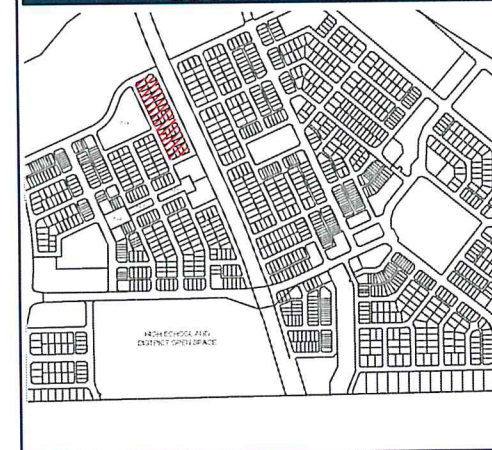

NOTE:  
Pavements and footpaths shown diagrammatically only

ATELIER VILLAGE  
DETAILED AREA PLAN No. 3 (As Amended)  
LOT 9019 MARMION AVENUE, ALKIMOS  
TRINITY ESTATE

LWP  
bringing communities to life

GRAY & LEWIS  
LAND USE PLANNERS  
Suite 5, 2 Hardy Street  
South Perth, WA 6151  
T (08) 9474 1722  
F (08) 9474 1172  
perth@graylewis.com.au

# ATTACHMENT 1 - BUILDING FAÇADE TREATMENTS (QUIET HOUSE DESIGN REQUIREMENTS).

## PROVISIONS AS PER LLOYD GEORGE TRANSPORTATION NOISE ASSESSMENT

Package A: House Facade In Areas Where Noise Levels Exceed The Noise 'Target' But Are Within The 'Margin'		
Area Type	Orientation	Noise Control Measures
<b>Indoors</b>		
Bedrooms	Facing road / rail corridor	6mm (minimum) laminated glazing Fixed, casement or awning windows with seals No external doors Closed eaves No vents to outside walls / eaves Mechanical ventilation / air-conditioning <sup>1</sup>
	Side-on to corridor	6mm (minimum) laminated glazing Closed eaves Mechanical ventilation / air-conditioning <sup>1</sup>
	Away from corridor	No requirements
Living and work areas <sup>2</sup>	Facing corridor	6mm (minimum) laminated glazing Fixed, casement or awning windows with seals 35mm (minimum) solid core external doors with acoustic seals <sup>3</sup> Sliding doors must be filled with acoustic seals Closed eaves No vents to outside walls / eaves Mechanical ventilation / air-conditioning <sup>1</sup>
	Side-on to corridor	6mm (minimum) laminated glazing Closed eaves Mechanical ventilation / air-conditioning <sup>1</sup>
	Away from corridor	No requirements
Other indoor areas	Any	No requirements
<b>Outdoors</b>		
Outdoor living area		See Note 4 below
<b>Package B: Noise within 3dB above the 'limit'</b> The following noise insulation package is designed to meet the indoor noise standards for residential developments in areas where transport noise levels exceed the noise 'limit' but by no more than 3dB (See Table 1 in the Policy)		
Area Type	Orientation	Noise Control Measures
<b>Indoors</b>		
Bedrooms	Facing road / rail corridor	10mm (minimum) laminated glazing Fixed, casement or awning windows with seals <sup>3</sup> No external doors Closed eaves No vents to outside walls / eaves Mechanical ventilation / air-conditioning <sup>1</sup>
	Side-on to corridor	10mm (minimum) laminated glazing Closed eaves Mechanical ventilation / air-conditioning <sup>1</sup>
	Away from corridor	No requirements
Living and work areas <sup>2</sup>	Facing corridor	10mm (minimum) laminated glazing Fixed, casement or awning windows with seals 40mm solid core external doors with acoustic seals <sup>3</sup> Sliding doors must be filled with acoustic seals Closed eaves No vents to outside walls / eaves Mechanical ventilation / air-conditioning <sup>1</sup>
	Side-on to corridor	6mm (minimum) laminated glazing Closed eaves Mechanical ventilation / air-conditioning <sup>1</sup>
	Away from corridor	No requirements
Other indoor areas	Any	No requirements
<b>Outdoors</b>		
Outdoor living area		See Note 4 below

1. See section on Mechanical ventilation / air-conditioning below for further details and requirements.

2. These deemed-to-comply guidelines adopt the definitions of indoor spaces used in AS 2107-2000. A comparable description for bedrooms, living and work areas is that defined by the Building Guide of Australia as a 'habitable room'. The Building Guide of Australia may be referenced if greater clarity is needed. A living or work area can be taken to mean any 'habitable room' other than a bedroom. Note that there are no noise insulation requirements for utility areas such as bathrooms. The Building Guide of Australia describes these utility spaces as 'non-habitable rooms'.

3. Glazing panels are acceptable in external doors facing the transport corridor. However these must meet the minimum glazing requirements.

4. The policy requires that at least one outdoor living area be reasonably protected from transport noise. The protected area should meet the minimum space requirements for outdoor living areas, as defined in the Residential Design Codes of Western Australia or as amended in the DAP.

### Mechanical ventilation / air conditioning

Where outdoor noise levels are above the 'target', both packages A and B require mechanical ventilation or air-conditioning to ensure that windows can remain closed in order to achieve the indoor noise standards. In implementing Packages A and B, the following need to be observed:

- Evaporative air-conditioning systems will not meet the requirements for Packages A and B because windows need to remain open;
- Refrigerative air-conditioning systems need to be designed to achieve fresh air ventilation requirements;
- Air inlets need to be positioned facing away from the transport corridor where practicable;
- Ductwork needs to be provided with adequate silencing to prevent noise intrusion.